


# CJMV (wall installation, H=500mm)

Air flow - Pressure drop - Sound pressure level, LpA  
 Reported dB(A) values in diagram apply to a room attenuation of 4 dB

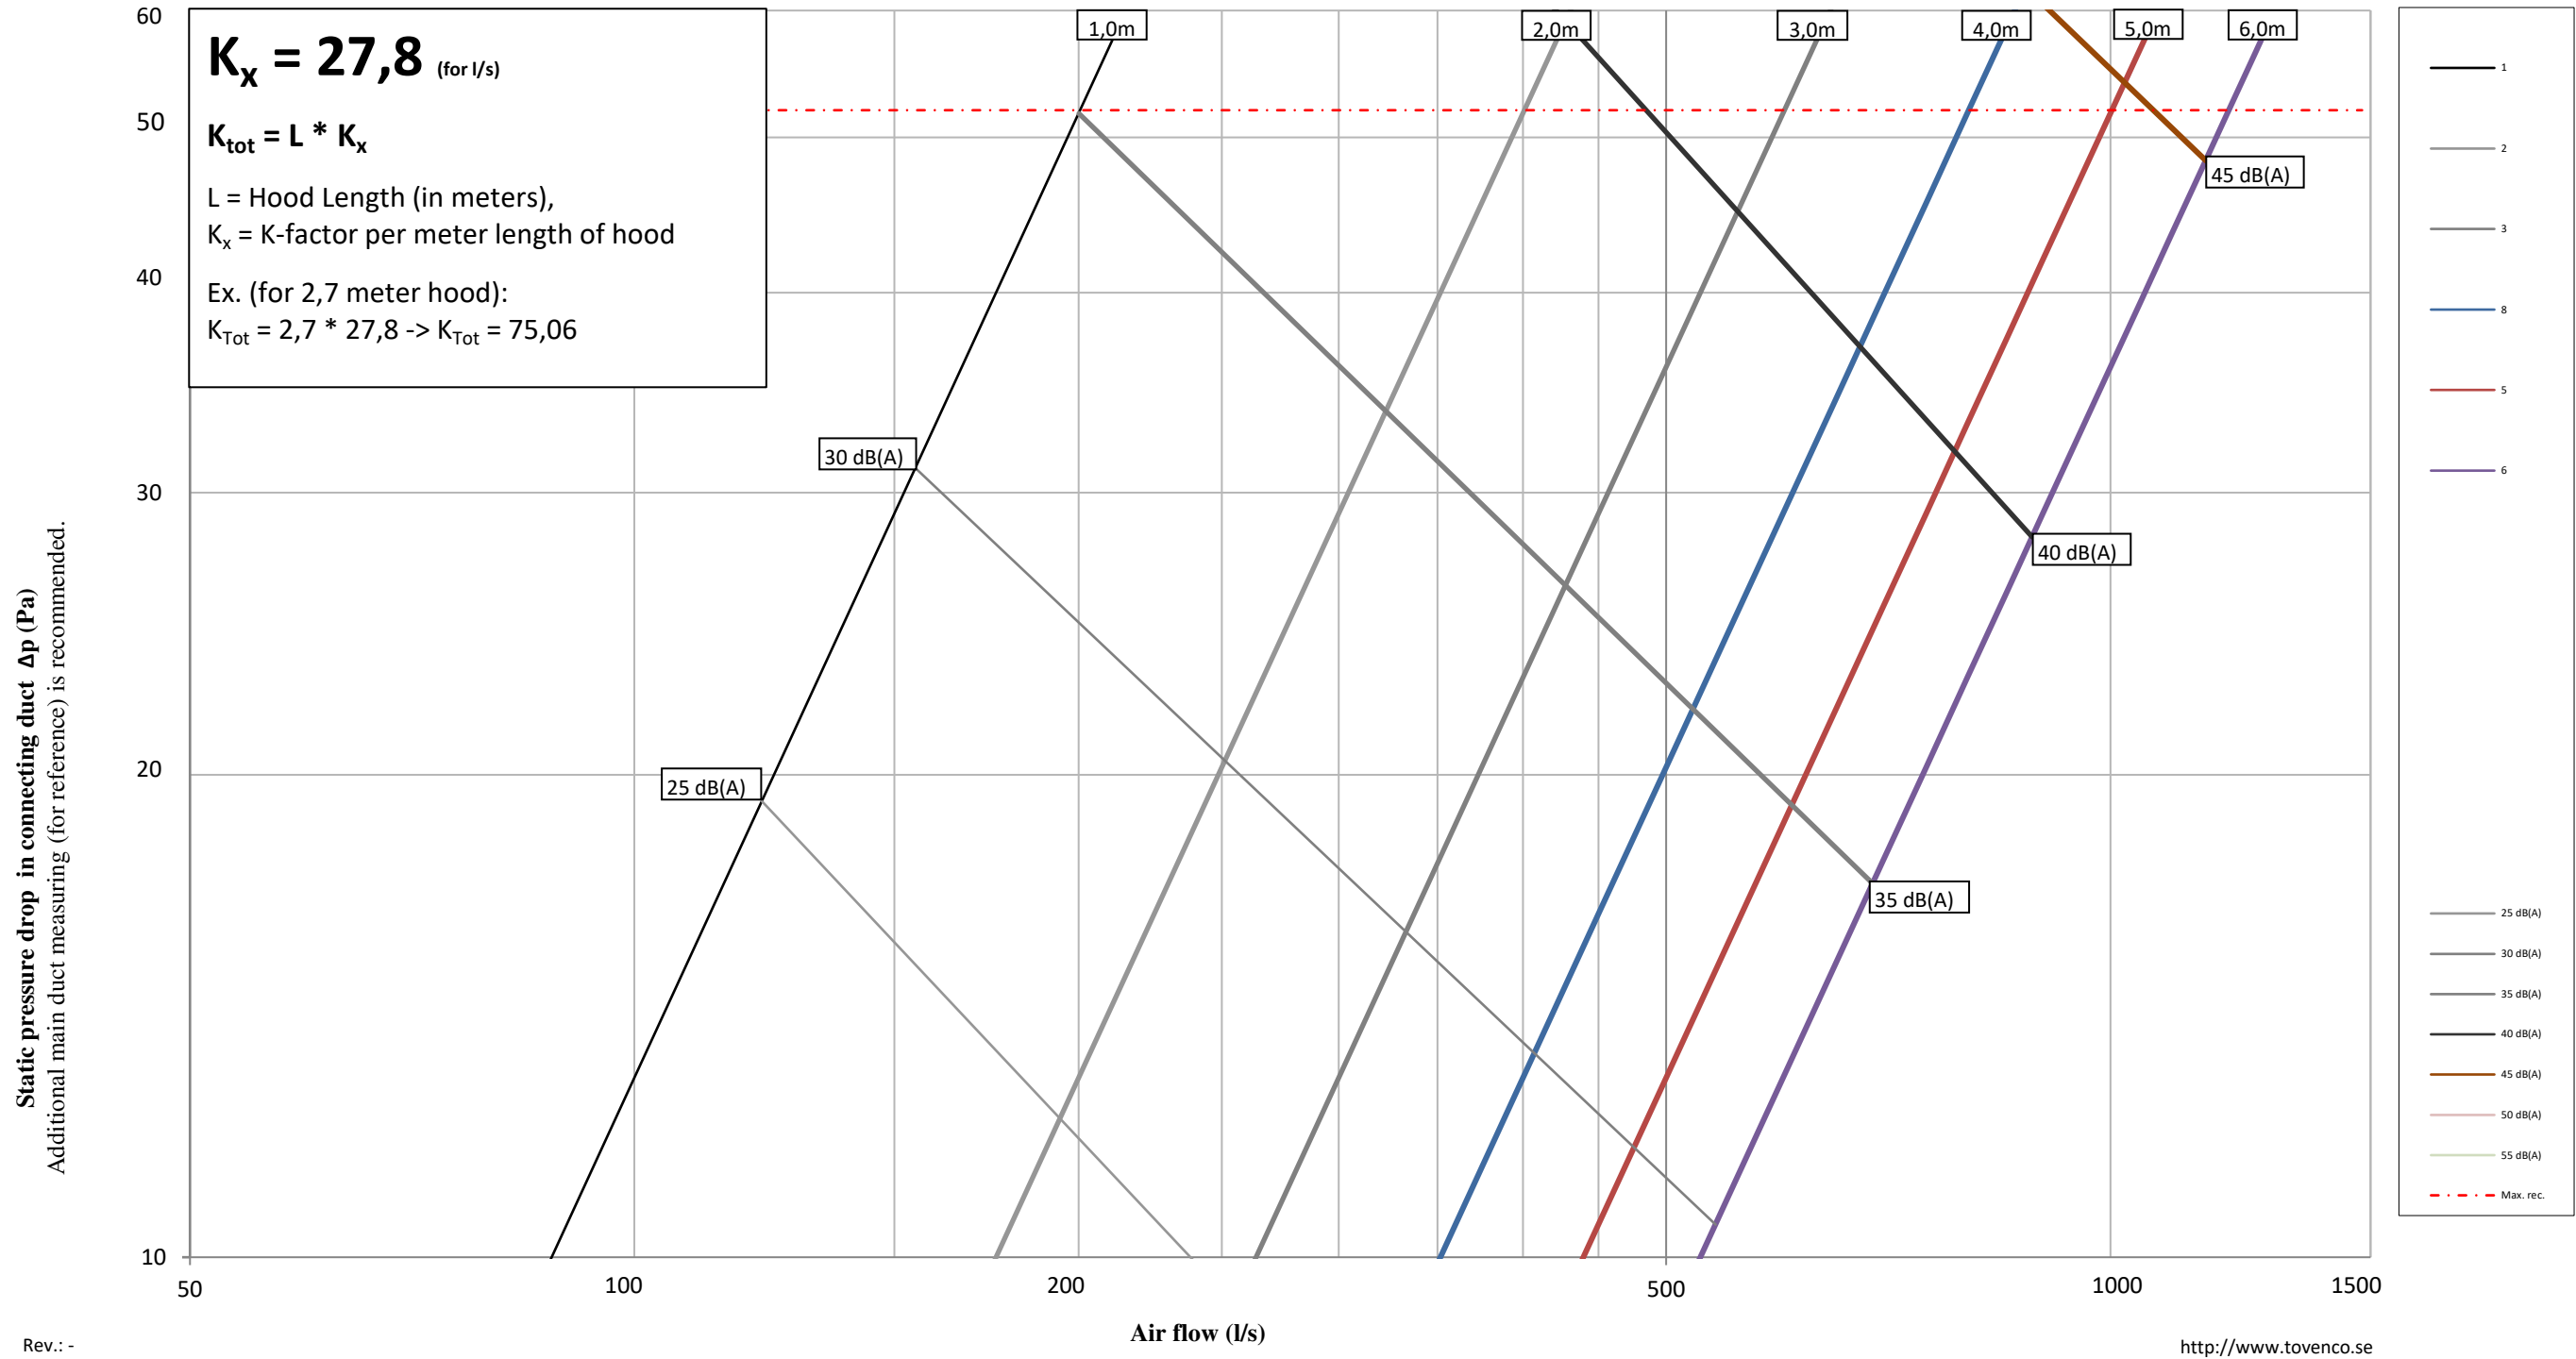

Rev.: -

<http://www.tovenco.se>

$L_{w_{okt}} = L_{pA} + K$								
f (Hz)	63	125	250	500	1k	2k	4k	8k
K (dB)	-26	-16	-9	-3	-	1	1	-2

Attenuation (total sound reduction, including end reflection.)								
Dt (dB)	18	14	8	6	9	14	18	22